

## Form C: Type Test Verification Report

All Micro-generators connected to the **DNO Distribution Network** shall be **Fully Type Tested**. This form is the **Manufacturer's** declaration of compliance with the requirements of EREC G98.

This form should be used when making a Type Test submission to the Energy Networks Association (ENA) Type Test Register.

If the **Micro-generator** is **Fully Type Tested** and already registered with the ENA Type Test Register, the **Installation Document** should include the **Manufacturer's** Reference Number (the system reference), and this form does not need to be submitted.

<b>Manufacturer's</b> reference number		FOXES/04183/V1	
<b>Micro-generator</b> technology		Grid-tied photovoltaic inverter	
<b>Manufacturer</b> name		FOXESS Co., Ltd.	
Address		Room A203, Building C, No 205, Binhai Six Road, New Airport Industry Area, Longwan District, Wenzhou, Zhejiang Province, China	
Tel	+86-0510-68092998	Fax	
E-mail	info@fox-ess.com	Web site	www.fox-ess.com
<b>Registered Capacity</b> , use separate sheet if more than one connection option.	Connection Option		
	3.3	kW single phase	
	3.0	kW single phase	
	2.5	kW single phase	
	2.0	kW single phase	
	1.5	kW single phase	
	1.0	kW single phase	
	0.7	kW single phase	
<b>Manufacturer Type Test</b> declaration. - I certify that all products supplied by the company with the above <b>Fully Type Tested</b> reference number will be manufactured and tested to ensure that they perform as stated in this document, prior to shipment to site and that no site modifications are required to ensure that the product meets all the requirements of EREC G98.			
Signed		On behalf of	FOXESS Co., Ltd.
<p>Note that testing can be done by the <b>Manufacturer</b> of an individual component or by an external test house.</p> <p>Where parts of the testing are carried out by persons or organisations other than the <b>Manufacturer</b> then that person or organisation shall keep copies of all test records and results supplied to them to verify that the testing has been carried out by people with sufficient technical competency to carry out the tests.</p>			

**Operating Range:** This test should be carried out as specified in A.1.2.10.

Pass or failure of the test should be indicated in the fields below (right hand side), for example with the statement "Pass", "No disconnection occurs", etc. Graphical evidence is preferred.


**Test 1**

Voltage = 85% of nominal (195.5 V)

Frequency = 47.0 Hz

Power factor = 1

Period of test 20 seconds

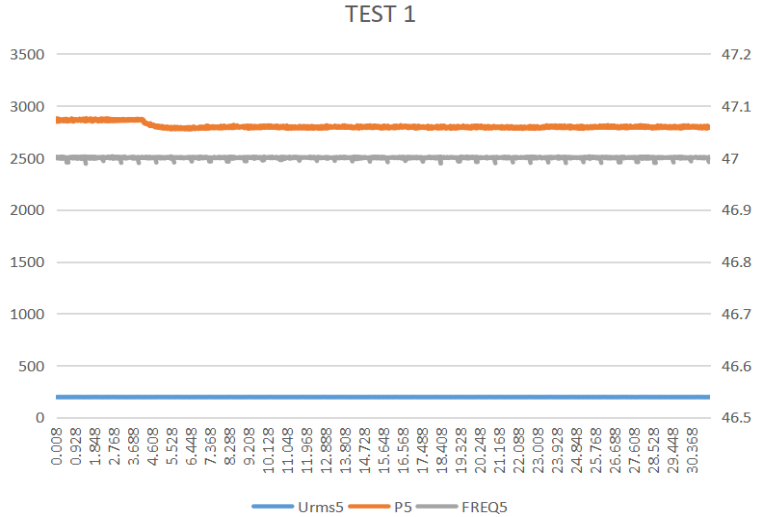


**Test 2**

Voltage = 85% of nominal (195.5 V)

Frequency = 47.5 Hz

Power factor = 1

Period of test 90 minutes

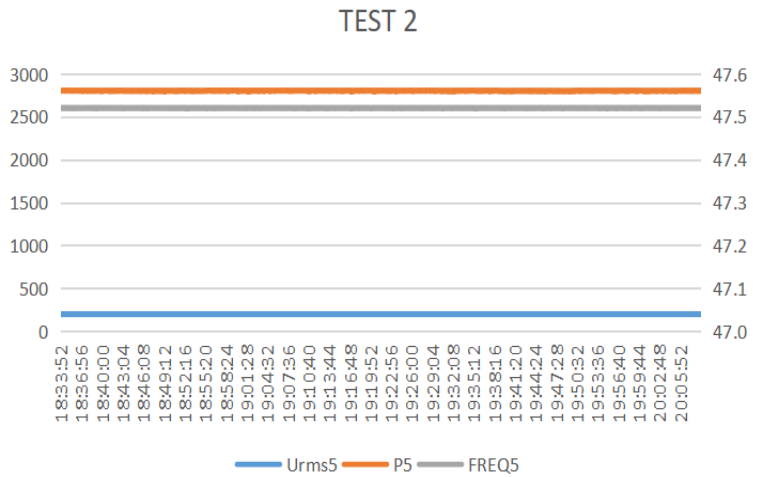


**Test 3**

Voltage = 110% of nominal (253 V).

Frequency = 51.5 Hz

Power factor = 1

Period of test 90 minutes

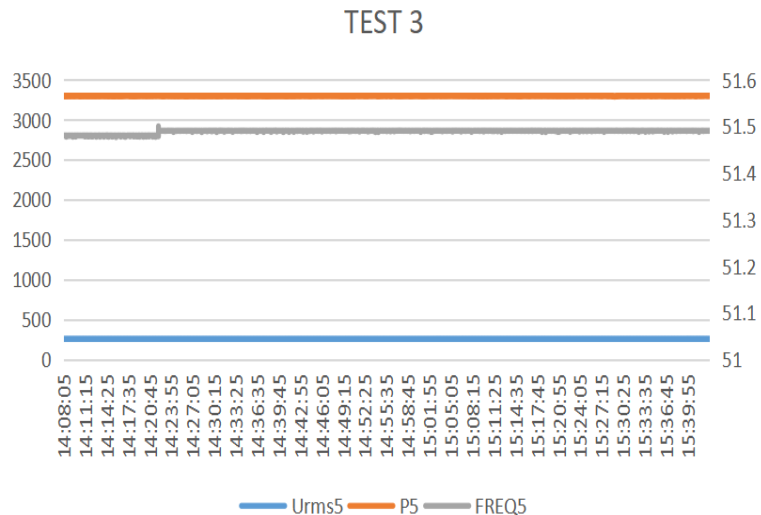

<p>Test 4</p> <p>Voltage = 110% of nominal (253 V).</p> <p>Frequency = 52.0 Hz</p> <p>Power factor = 1</p> <p>Period of test 15 minutes</p>	<p style="text-align: center;">TEST 4</p> <p style="text-align: center;">Legend: Urms5 (blue), P5 (orange), FREQ5 (grey)</p>																				
<p>Test 5</p> <p>Voltage = 100% of nominal (230 V).</p> <p>Frequency = 50.0 Hz</p> <p>Power factor = 1</p> <p>Period of test 90 minutes</p>	<p style="text-align: center;">TEST 5</p> <p style="text-align: center;">Legend: Urms5 (blue), P5 (orange), FREQ5 (grey)</p>																				
<p>Test 6 RoCoF withstand</p> <p>Confirm that the <b>Micro-Generating Plant</b> is capable of staying connected to the <b>Distribution Network</b> and operate at rates of change of frequency up to 1 Hz<sup>s</sup><sup>-8</sup> as measured over a period of 500 ms.</p>	<p>No disconnection</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>項目</th> <th>A</th> <th>B</th> <th>規格</th> <th>許容値</th> </tr> </thead> <tbody> <tr> <td>AV1@TRIM(4_631) [V]</td> <td>641.1958</td> <td>843.0378</td> <td>1.99940</td> <td>230.5023</td> </tr> <tr> <td>AV1@TRIM(4_631) [A]</td> <td>17.78061</td> <td>16.22981</td> <td>-1.510104</td> <td>14.26657</td> </tr> <tr> <td>F_Nom@AC [Hz]</td> <td>49.08229</td> <td>50.99940</td> <td>1.992111</td> <td>50.02656</td> </tr> </tbody> </table>	項目	A	B	規格	許容値	AV1@TRIM(4_631) [V]	641.1958	843.0378	1.99940	230.5023	AV1@TRIM(4_631) [A]	17.78061	16.22981	-1.510104	14.26657	F_Nom@AC [Hz]	49.08229	50.99940	1.992111	50.02656
項目	A	B	規格	許容値																	
AV1@TRIM(4_631) [V]	641.1958	843.0378	1.99940	230.5023																	
AV1@TRIM(4_631) [A]	17.78061	16.22981	-1.510104	14.26657																	
F_Nom@AC [Hz]	49.08229	50.99940	1.992111	50.02656																	

**Power Quality – Harmonics:** These tests should be carried out as specified in BS EN 61000-3-2. The chosen test should be undertaken with a fixed source of energy at two power levels a) between 45 and 55% and b) at 100% of **Registered Capacity**. The test requirements are specified in Annex A1 A.1.3.1 (**Inverter** connected) or Annex A2 A.2.3.1 (Synchronous).

**Micro-generator** tested to BS EN 61000-3-2

<b>Micro-generator</b> rating per phase (rpp)	3.3	kW	
---	-----	----	--

For 3-phase **Micro-generators**, tick this box if harmonic measurements are identical for all three phases. If the harmonics are not identical for each phase, please replicate this section with the results for each phase.

Harmonic	At 45-55% of <b>Registered Capacity</b> <sup>1</sup>		100% of <b>Registered Capacity</b>		Limit in BS EN 61000-3-2 in Amps	Higher limit for odd harmonics 21 and above
	Measured Value	Value	Measured Value	Value		
	Measured	Value	Measured	Value	Limit in BS	Higher limit for
	MV in Amps		MV in Amps		EN 61000-3-2 in Amps	odd harmonics
						21 and above
2	0.011		0.038		1.080	
3	0.068		0.084		2.300	
4	0.014		0.035		0.430	
5	0.029		0.032		1.140	
6	0.022		0.034		0.300	
7	0.025		0.030		0.770	
8	0.019		0.027		0.230	
9	0.038		0.054		0.400	
10	0.008		0.020		0.184	
11	0.022		0.022		0.330	
12	0.006		0.021		0.153	
13	0.006		0.018		0.210	
14	0.008		0.019		0.131	
15	0.020		0.022		0.150	
16	0.004		0.009		0.115	
17	0.014		0.018		0.132	

<sup>1</sup> See the note in A.2.3.1 if 45-55% of **Registered Capacity** is below the minimum stable operating level. If an alternative loading level is chosen, the level should be indicated on the test form and the reason for not testing at 45-55% of **Registered Capacity** should be stated. The additional comments box at the end of the harmonics test sheet can be used for this.

18	0.008		0.009		0.102	
19	0.004		0.010		0.118	
20	0.008		0.008		0.092	
21	0.007		0.006		0.107	0.160
22	0.002		0.006		0.084	
23	0.010		0.017		0.098	0.147
24	0.009		0.010		0.077	
25	0.006		0.014		0.090	0.135
26	0.002		0.004		0.071	
27	0.004		0.005		0.083	0.124
28	0.008		0.005		0.066	
29	0.003		0.004		0.078	0.117
30	0.002		0.007		0.061	
31	0.009		0.011		0.073	0.109
32	0.008		0.004		0.058	
33	0.003		0.014		0.068	0.102
34	0.002		0.007		0.054	
35	0.005		0.005		0.064	0.096
36	0.006		0.001		0.051	
37	0.002		0.003		0.061	0.091
38	0.005		0.005		0.048	
39	0.002		0.008		0.058	0.087
40	0.004		0.004		0.046	
<b>Micro-generator</b> tested to BS EN 61000-3-2						
<b>Micro-generator</b> rating per phase (rpp)			3.0		kW	
For 3-phase <b>Micro-generators</b> , tick this box if harmonic measurements are identical for all three phases. If the harmonics are not identical for each phase, please replicate this section with the results for each phase.						

Harmonic	At 45-55% of <b>Registered Capacity</b> <sup>2</sup>		100% of <b>Registered Capacity</b>		Limit in BS EN 61000-3-2 in Amps	Higher limit for odd harmonics 21 and above
	Measured Value	MV in Amps	Measured Value	MV in Amps		
2	0.007		0.027		1.080	
3	0.069		0.081		2.300	
4	0.013		0.016		0.430	
5	0.027		0.034		1.140	
6	0.018		0.027		0.300	
7	0.024		0.024		0.770	
8	0.016		0.034		0.230	
9	0.032		0.048		0.400	
10	0.007		0.032		0.184	
11	0.019		0.020		0.330	
12	0.004		0.021		0.153	
13	0.005		0.023		0.210	
14	0.008		0.012		0.131	
15	0.017		0.014		0.150	
16	0.004		0.016		0.115	
17	0.012		0.022		0.132	
18	0.007		0.007		0.102	
19	0.005		0.011		0.118	
20	0.008		0.004		0.092	
21	0.005		0.003		0.107	0.160
22	0.002		0.005		0.084	
23	0.006		0.013		0.098	0.147
24	0.007		0.005		0.077	

<sup>2</sup> See the note in A.2.3.1 if 45-55% of **Registered Capacity** is below the minimum stable operating level. If an alternative loading level is chosen, the level should be indicated on the test form and the reason for not testing at 45-55% of **Registered Capacity** should be stated. The additional comments box at the end of the harmonics test sheet can be used for this.

25	0.005		0.015		0.090	0.135
26	0.002		0.010		0.071	
27	0.004		0.005		0.083	0.124
28	0.007		0.006		0.066	
29	0.002		0.002		0.078	0.117
30	0.003		0.005		0.061	
31	0.006		0.007		0.073	0.109
32	0.008		0.001		0.058	
33	0.004		0.012		0.068	0.102
34	0.001		0.005		0.054	
35	0.005		0.007		0.064	0.096
36	0.006		0.005		0.051	
37	0.001		0.003		0.061	0.091
38	0.005		0.004		0.048	
39	0.002		0.004		0.058	0.087
40	0.003		0.005		0.046	
<b>Micro-generator</b> tested to BS EN 61000-3-2						
<b>Micro-generator</b> rating per phase (rpp)			2.5		kW	
For 3-phase <b>Micro-generators</b> , tick this box if harmonic measurements are identical for all three phases. If the harmonics are not identical for each phase, please replicate this section with the results for each phase.						
Harmo nic	At 45-55% of <b>Registered Capacity</b> <sup>3</sup>		100% of <b>Registered Capacity</b>			
	Measured Value MV in Amps		Measured Value MV in Amps		Limit in BS EN 61000-3- 2 in Amps	Higher limit for odd harmonics 21 and above
2	0.013		0.018		1.080	
3	0.069		0.074		2.300	

<sup>3</sup> See the note in A.2.3.1 if 45-55% of **Registered Capacity** is below the minimum stable operating level. If an alternative loading level is chosen, the level should be indicated on the test form and the reason for not testing at 45-55% of **Registered Capacity** should be stated. The additional comments box at the end of the harmonics test sheet can be used for this.

4	0.010		0.027		0.430	
5	0.025		0.031		1.140	
6	0.013		0.028		0.300	
7	0.019		0.024		0.770	
8	0.011		0.021		0.230	
9	0.020		0.034		0.400	
10	0.006		0.012		0.184	
11	0.016		0.031		0.330	
12	0.005		0.007		0.153	
13	0.006		0.012		0.210	
14	0.005		0.009		0.131	
15	0.010		0.015		0.150	
16	0.002		0.007		0.115	
17	0.009		0.018		0.132	
18	0.004		0.008		0.102	
19	0.007		0.003		0.118	
20	0.004		0.003		0.092	
21	0.003		0.005		0.107	0.160
22	0.002		0.005		0.084	
23	0.004		0.011		0.098	0.147
24	0.005		0.007		0.077	
25	0.002		0.012		0.090	0.135
26	0.002		0.004		0.071	
27	0.007		0.002		0.083	0.124
28	0.006		0.006		0.066	
29	0.003		0.002		0.078	0.117
30	0.003		0.003		0.061	
31	0.003		0.009		0.073	0.109
32	0.008		0.004		0.058	



33	0.006		0.008		0.068	0.102
34	0.003		0.006		0.054	
35	0.008		0.002		0.064	0.096
36	0.007		0.002		0.051	
37	0.002		0.002		0.061	0.091
38	0.004		0.007		0.048	
39	0.003		0.003		0.058	0.087
40	0.002		0.005		0.046	
<b>Micro-generator</b> tested to BS EN 61000-3-2						
<b>Micro-generator</b> rating per phase (rpp)			2.0		kW	
For 3-phase <b>Micro-generators</b> , tick this box if harmonic measurements are identical for all three phases. If the harmonics are not identical for each phase, please replicate this section with the results for each phase.						
Harmo nic	At 45-55% of <b>Registered Capacity</b> <sup>4</sup>		100% of <b>Registered Capacity</b>			
	Measured Value MV in Amps		Measured Value MV in Amps		Limit in BS EN 61000-3- 2 in Amps	Higher limit for odd harmonics 21 and above
2	0.011		0.014		1.080	
3	0.065		0.068		2.300	
4	0.004		0.018		0.430	
5	0.020		0.032		1.140	
6	0.008		0.023		0.300	
7	0.013		0.021		0.770	
8	0.007		0.019		0.230	
9	0.009		0.042		0.400	
10	0.007		0.014		0.184	
11	0.007		0.025		0.330	

<sup>4</sup> See the note in A.2.3.1 if 45-55% of **Registered Capacity** is below the minimum stable operating level. If an alternative loading level is chosen, the level should be indicated on the test form and the reason for not testing at 45-55% of **Registered Capacity** should be stated. The additional comments box at the end of the harmonics test sheet can be used for this.

12	0.003		0.005		0.153	
13	0.008		0.008		0.210	
14	0.003		0.004		0.131	
15	0.004		0.017		0.150	
16	0.002		0.004		0.115	
17	0.004		0.016		0.132	
18	0.003		0.007		0.102	
19	0.010		0.002		0.118	
20	0.004		0.005		0.092	
21	0.004		0.006		0.107	0.160
22	0.002		0.003		0.084	
23	0.002		0.011		0.098	0.147
24	0.005		0.007		0.077	
25	0.004		0.010		0.090	0.135
26	0.003		0.003		0.071	
27	0.009		0.002		0.083	0.124
28	0.006		0.007		0.066	
29	0.003		0.002		0.078	0.117
30	0.005		0.002		0.061	
31	0.003		0.010		0.073	0.109
32	0.006		0.007		0.058	
33	0.009		0.003		0.068	0.102
34	0.004		0.003		0.054	
35	0.008		0.004		0.064	0.096
36	0.008		0.005		0.051	
37	0.005		0.002		0.061	0.091
38	0.004		0.006		0.048	
39	0.006		0.003		0.058	0.087
40	0.002		0.004		0.046	

Micro-generator tested to BS EN 61000-3-2						
Micro-generator rating per phase (rpp)		1.5		kW		
For 3-phase <b>Micro-generators</b> , tick this box if harmonic measurements are identical for all three phases. If the harmonics are not identical for each phase, please replicate this section with the results for each phase.						
Harmonic	At 45-55% of <b>Registered Capacity</b> <sup>5</sup>		100% of <b>Registered Capacity</b>			
	Measured Value	Value	Measured Value	Value	Limit in BS EN 61000-3-2 in Amps	Higher limit for odd harmonics 21 and above
	MV in Amps		MV in Amps			
2	0.009		0.017		1.080	
3	0.060		0.069		2.300	
4	0.004		0.012		0.430	
5	0.011		0.024		1.140	
6	0.011		0.005		0.300	
7	0.009		0.023		0.770	
8	0.006		0.003		0.230	
9	0.011		0.029		0.400	
10	0.003		0.003		0.184	
11	0.010		0.015		0.330	
12	0.004		0.005		0.153	
13	0.013		0.010		0.210	
14	0.002		0.005		0.131	
15	0.007		0.012		0.150	
16	0.003		0.004		0.115	
17	0.004		0.009		0.132	
18	0.003		0.002		0.102	
19	0.015		0.003		0.118	

<sup>5</sup> See the note in A.2.3.1 if 45-55% of **Registered Capacity** is below the minimum stable operating level. If an alternative loading level is chosen, the level should be indicated on the test form and the reason for not testing at 45-55% of **Registered Capacity** should be stated. The additional comments box at the end of the harmonics test sheet can be used for this.

20	0.004		0.004		0.092	
21	0.008		0.005		0.107	0.160
22	0.002		0.003		0.084	
23	0.005		0.009		0.098	0.147
24	0.004		0.004		0.077	
25	0.007		0.003		0.090	0.135
26	0.001		0.006		0.071	
27	0.010		0.004		0.083	0.124
28	0.006		0.003		0.066	
29	0.007		0.007		0.078	0.117
30	0.003		0.007		0.061	
31	0.007		0.002		0.073	0.109
32	0.007		0.004		0.058	
33	0.008		0.006		0.068	0.102
34	0.003		0.005		0.054	
35	0.009		0.002		0.064	0.096
36	0.007		0.006		0.051	
37	0.007		0.002		0.061	0.091
38	0.004		0.003		0.048	
39	0.008		0.003		0.058	0.087
40	0.001		0.001		0.046	
<b>Micro-generator</b> tested to BS EN 61000-3-2						
<b>Micro-generator</b> rating per phase (rpp)			1.0	kW		
For 3-phase <b>Micro-generators</b> , tick this box if harmonic measurements are identical for all three phases. If the harmonics are not identical for each phase, please replicate this section with the results for each phase.						
Harmonic	At 45-55% of <b>Registered Capacity</b> <sup>6</sup>		100% of <b>Registered Capacity</b>			

<sup>6</sup> See the note in A.2.3.1 if 45-55% of **Registered Capacity** is below the minimum stable operating level. If an alternative loading level is chosen, the level should be indicated on the test form and the reason for not testing

	Measured Value MV in Amps		Measured Value MV in Amps		Limit in BS EN 61000-3- 2 in Amps	Higher limit for odd harmonics 21 and above
2	0.006		0.008		1.080	
3	0.051		0.061		2.300	
4	0.007		0.007		0.430	
5	0.017		0.024		1.140	
6	0.013		0.009		0.300	
7	0.015		0.014		0.770	
8	0.007		0.006		0.230	
9	0.027		0.010		0.400	
10	0.003		0.005		0.184	
11	0.022		0.004		0.330	
12	0.003		0.007		0.153	
13	0.026		0.003		0.210	
14	0.002		0.002		0.131	
15	0.015		0.007		0.150	
16	0.006		0.008		0.115	
17	0.051		0.061		0.132	
18	0.007		0.007		0.102	
19	0.017		0.024		0.118	
20	0.013		0.009		0.092	
21	0.015		0.014		0.107	0.160
22	0.007		0.006		0.084	
23	0.027		0.010		0.098	0.147
24	0.003		0.005		0.077	
25	0.022		0.004		0.090	0.135
26	0.003		0.007		0.071	

at 45-55% of **Registered Capacity** should be stated. The additional comments box at the end of the harmonics test sheet can be used for this.

27	0.026		0.003		0.083	0.124
28	0.002		0.002		0.066	
29	0.015		0.007		0.078	0.117
30	0.004		0.002		0.061	
31	0.015		0.005		0.073	0.109
32	0.004		0.003		0.058	
33	0.017		0.006		0.068	0.102
34	0.004		0.002		0.054	
35	0.009		0.009		0.064	0.096
36	0.002		0.004		0.051	
37	0.011		0.002		0.061	0.091
38	0.004		0.002		0.048	
39	0.009		0.002		0.058	0.087
40	0.003		0.003		0.046	
<b>Micro-generator</b> tested to BS EN 61000-3-2						
<b>Micro-generator</b> rating per phase (rpp)			0.7		kW	
For 3-phase <b>Micro-generators</b> , tick this box if harmonic measurements are identical for all three phases. If the harmonics are not identical for each phase, please replicate this section with the results for each phase.						
Harmo nic	At 45-55% of <b>Registered Capacity</b> <sup>7</sup>		100% of <b>Registered Capacity</b>			
	Measured Value MV in Amps		Measured Value MV in Amps		Limit in BS EN 61000-3- 2 in Amps	Higher limit for odd harmonics 21 and above
2	0.019		0.014		1.080	
3	0.047		0.057		2.300	
4	0.004		0.007		0.430	
5	0.027		0.010		1.140	

<sup>7</sup> See the note in A.2.3.1 if 45-55% of **Registered Capacity** is below the minimum stable operating level. If an alternative loading level is chosen, the level should be indicated on the test form and the reason for not testing at 45-55% of **Registered Capacity** should be stated. The additional comments box at the end of the harmonics test sheet can be used for this.

6	0.009		0.009		0.300	
7	0.022		0.009		0.770	
8	0.005		0.005		0.230	
9	0.045		0.015		0.400	
10	0.002		0.002		0.184	
11	0.033		0.012		0.330	
12	0.004		0.003		0.153	
13	0.030		0.014		0.210	
14	0.002		0.002		0.131	
15	0.017		0.009		0.150	
16	0.003		0.003		0.115	
17	0.014		0.008		0.132	
18	0.002		0.003		0.102	
19	0.011		0.014		0.118	
20	0.003		0.002		0.092	
21	0.007		0.009		0.107	0.160
22	0.002		0.002		0.084	
23	0.008		0.007		0.098	0.147
24	0.003		0.003		0.077	
25	0.002		0.009		0.090	0.135
26	0.002		0.002		0.071	
27	0.005		0.010		0.083	0.124
28	0.005		0.005		0.066	
29	0.002		0.008		0.078	0.117
30	0.003		0.004		0.061	
31	0.002		0.008		0.073	0.109
32	0.006		0.006		0.058	
33	0.008		0.008		0.068	0.102
34	0.003		0.004		0.054	

35	0.011		0.008		0.064	0.096
36	0.008		0.008		0.051	
37	0.006		0.008		0.061	0.091
38	0.003		0.002		0.048	
39	0.007		0.008		0.058	0.087
40	0.002		0.002		0.046	

Note the higher limits for odd harmonics 21 and above are only allowable under certain conditions, if these higher limits are utilised please state the exemption used as detailed in part 6.2.3.4 of BS EN 61000-3-2 in the box below.

**Power Quality – Voltage fluctuations and Flicker:** These tests should be undertaken in accordance with EREC G98 Annex A1 A.1.3.3 (**Inverter** connected) or Annex A2 A.2.3.3 (Synchronous).

The standard test impedance is 0.4  $\Omega$  for a single phase **Micro-generating Plant** (and for a two phase unit in a three phase system) and 0.24  $\Omega$  for a three phase **Micro-generating Plant** (and for a two phase unit in a split phase system). Please ensure that both test and standard impedance are completed on this form. If the test impedance (or the measured impedance) is different to the standard impedance, it must be normalised to the standard impedance as follows (where the **Power Factor** of the generation output is 0.98 or above):

$d$  max normalised value = (Standard impedance / Measured impedance) x Measured value.

Where the **Power Factor** of the output is under 0.98 then the X to R ratio of the test impedance should be close to that of the standard impedance.

The stopping test should be a trip from full load operation.

The duration of these tests needs to comply with the particular requirements set out in the testing notes for the technology under test.

The test date and location must be declared.

Test start date	2021-11-04			Test end date	2021-11-04			
Test location	No.1255, Jinhai Road, Pudong New District, Shanghai City, China							
	Starting			Stopping			Running	
	d(max)	d(c)	d(t)	d(max)	d(c)	d(t)	P <sub>st</sub>	P <sub>lt</sub> 2 hours
Measured Values at test impedance	0.5165	0.001	0	0.4777	0.4364	0	0.0248	0.0627
Normalised to standard impedance	0	0	0	0	0	0	0.07	0.07
Normalised to required maximum impedance	NA	NA	NA	NA	NA	NA	NA	NA
Limits set under BS EN 61000-3-11	4%	3.3%	3.3%	4%	3.3%	3.3%	1.0	0.65



Test Impedance	R	0.4	Ω	X	0.25	Ω
Standard Impedance	R	0.24 * 0.4 ^	Ω	X	0.15 * 0.25 ^	Ω
Maximum Impedance	R		Ω	X		Ω
<p>*Applies to three phase and split single phase <b>Micro-generators</b>. Delete as appropriate.          ^ Applies to single phase <b>Micro-generators</b> and <b>Micro-generators</b> using two phases on a three phase system. Delete as appropriate.</p>						

<p><b>Power quality – DC injection:</b> This test should be carried out in accordance with A 1.3.4 as applicable.          The % <b>DC</b> injection (“as % of rated AC current” below) is calculated as follows:  <math>\% \text{ DC injection} = \text{Recorded DC value in Amps} / \text{base current}</math>          where the base current is the <b>Registered Capacity (W) / 230 V</b>. The % <b>DC</b> injection should not be greater than 0.25%.</p>				
3.3 kW				
Test power level	20%	50%	75%	100%
Recorded <b>DC</b> value in Amps	0.0063	0.0104	0.0123	0.0174
as % of rated AC current	0.04%	0.07%	0.09%	0.12%
Limit	0.25%	0.25%	0.25%	0.25%
3.0 kW				
Test power level	20%	50%	75%	100%
Recorded <b>DC</b> value in Amps	0.0057	0.0099	0.0094	0.0225
as % of rated AC current	0.04%	0.08%	0.07%	0.17%
Limit	0.25%	0.25%	0.25%	0.25%
2.5 kW				
Test power level	20%	50%	75%	100%
Recorded <b>DC</b> value in Amps	0.0069	0.0093	0.0094	0.0117
as % of rated AC current	0.06%	0.09%	0.09%	0.11%
Limit	0.25%	0.25%	0.25%	0.25%
2.0 kW				
Test power level	20%	50%	75%	100%

Recorded <b>DC</b> value in Amps	0.0108	0.0121	0.0073	0.0163
as % of rated AC current	0.12%	0.14%	0.08%	0.19%
Limit	0.25%	0.25%	0.25%	0.25%
<b>1.5 kW</b>				
Test power level	20%	50%	75%	100%
Recorded <b>DC</b> value in Amps	0.0077	0.0058	0.0070	0.0128
as % of rated AC current	0.12%	0.09%	0.11%	0.20%
Limit	0.25%	0.25%	0.25%	0.25%
<b>1.0 kW</b>				
Test power level	20%	50%	75%	100%
Recorded <b>DC</b> value in Amps	0.0090	0.0106	0.0075	0.097
as % of rated AC current	0.21%	0.24%	0.17%	0.22%
Limit	0.25%	0.25%	0.25%	0.25%
<b>0.7 kW</b>				
Test power level	20%	50%	75%	100%
Recorded <b>DC</b> value in Amps	0.0050	0.0071	0.0074	0.0066
as % of rated AC current	0.16%	0.23%	0.24%	0.22%
Limit	0.25%	0.25%	0.25%	0.25%

**Power Quality – Power factor:** This test shall be carried out in accordance with A.1.3.2 and A.2.3.2 at three voltage levels and at **Registered Capacity** and the measured **Power Factor** must be greater than 0.95 to pass. Voltage to be maintained within  $\pm 1.5\%$  of the stated level during the test.

<b>3.3 kW</b>			
	216.2 V	230 V	253 V
20% of <b>Registered Capacity</b>	0.994	0.994	0.994
50% of <b>Registered Capacity</b>	0.998	0.996	0.998
75% of <b>Registered Capacity</b>	0.998	0.998	0.999
100% of <b>Registered Capacity</b>	0.998	0.998	0.999
<b>Power Factor</b> Limit	>0.95	>0.95	>0.95
<b>3.0 kW</b>			

	216.2 V	230 V	253 V
<b>20% of Registered Capacity</b>	0.997	0.997	0.997
<b>50% of Registered Capacity</b>	0.999	0.999	0.999
<b>75% of Registered Capacity</b>	0.999	0.999	0.999
<b>100% of Registered Capacity</b>	0.999	0.999	0.999
<b>Power Factor Limit</b>	>0.95	>0.95	>0.95
<b>2.5 KW</b>			
	216.2 V	230 V	253 V
<b>20% of Registered Capacity</b>	0.996	0.996	0.995
<b>50% of Registered Capacity</b>	0.999	0.999	0.998
<b>75% of Registered Capacity</b>	0.999	0.999	0.999
<b>100% of Registered Capacity</b>	0.999	0.999	0.999
<b>Power Factor Limit</b>	>0.95	>0.95	>0.95
<b>2.0 KW</b>			
	216.2 V	230 V	253 V
<b>20% of Registered Capacity</b>	0.990	0.996	0.993
<b>50% of Registered Capacity</b>	0.998	0.998	0.998
<b>75% of Registered Capacity</b>	0.999	0.999	0.999
<b>100% of Registered Capacity</b>	0.999	0.999	0.999
<b>Power Factor Limit</b>	>0.95	>0.95	>0.95
<b>1.5 KW</b>			
	216.2 V	230 V	253 V
<b>20% of Registered Capacity</b>	0.981	0.984	0.989
<b>50% of Registered Capacity</b>	0.998	0.996	0.997
<b>75% of Registered Capacity</b>	0.999	0.999	0.998
<b>100% of Registered Capacity</b>	0.999	0.999	0.998
<b>Power Factor Limit</b>	>0.95	>0.95	>0.95
<b>1.0 KW</b>			
	216.2 V	230 V	253 V
<b>20% of Registered Capacity</b>	0.975	0.979	0.974
<b>50% of Registered Capacity</b>	0.992	0.993	0.996
<b>75% of Registered Capacity</b>	0.998	0.997	0.998
<b>100% of Registered Capacity</b>	0.999	0.998	0.998
<b>Power Factor Limit</b>	>0.95	>0.95	>0.95

0.7 KW			
	216.2 V	230 V	253 V
20% of <b>Registered Capacity</b>	0.961	0.953	0.955
50% of <b>Registered Capacity</b>	0.993	0.989	0.991
75% of <b>Registered Capacity</b>	0.993	0.994	0.996
100% of <b>Registered Capacity</b>	0.998	0.997	0.998
<b>Power Factor Limit</b>	>0.95	>0.95	>0.95

**Protection – Frequency tests:** These tests should be carried out in accordance with Annex A1 A.1.2.3 (**Inverter** connected) or Annex A2 A.2.2.3 (Synchronous). For trip tests, frequency and time delay should be stated. For “no trip tests”, “no trip” can be stated.

Function	Setting		Trip test		“No trip tests”	
	Frequency	Time delay	Frequency	Time delay	Frequency /time	Confirm no trip
U/F stage 1	47.5 Hz	20 s	47.48 Hz	20.164s	47.7 Hz 30 s	No trip
U/F stage 2	47 Hz	0.5 s	46.99 Hz	0.528s	47.2 Hz 19.5 s	No trip
					46.8 Hz 0.45 s	No trip
O/F stage 1	52 Hz	0.5 s	52.02Hz	0.586s	51.8 Hz 120.0 s	No trip
					52.2 Hz 0.45 s	No trip

Note. For frequency trip tests the frequency required to trip is the setting  $\pm 0.1$  Hz. In order to measure the time delay a larger deviation than the minimum required to operate the projection can be used. The “No trip tests” need to be carried out at the setting  $\pm 0.2$  Hz and for the relevant times as shown in the table above to ensure that the protection will not trip in error.

**Protection – Voltage tests:** These tests should be carried out in accordance with Annex A1 A.1.2.2 (**Inverter** connected) or Annex A2 A.2.2.2 (Synchronous). For trip tests, voltage and time delay should be stated. For “no trip tests”, “no trip” can be stated.

Function	Setting		Trip test		“No trip tests”	
	Voltage	Time delay	Voltage	Time delay	Voltage /time	Confirm no trip
U/V	184 V	2.5 s	183.4V	2.505s	188 V 5.0 s	No trip
					180 V 2.45 s	No trip
O/V stage 1	262.2 V	1.0 s	262.3V	1.002s	258.2 V 5.0 s	No trip
O/V stage 2	273.7 V	0.5 s	274.1V	0.512s	269.7 V 0.95 s	No trip

					277.7 V 0.45 s	No trip
--	--	--	--	--	-------------------	---------

Note for Voltage tests the Voltage required to trip is the setting  $\pm 3.45$  V. The time delay can be measured at a larger deviation than the minimum required to operate the protection. The No trip tests need to be carried out at the setting  $\pm 4$  V and for the relevant times as shown in the table above to ensure that the protection will not trip in error.

**Protection – Loss of Mains test:** For PV Inverters shall be tested in accordance with BS EN 62116. Other Micro-generators should be tested in accordance with A.2.2.4 at 10%, 55% and 100% of rated power.

For Inverters tested to BS EN 62116 the following sub set of tests should be recorded in the following table.

Test Power and imbalance	33% -5% Q Test 22	66% -5% Q Test 12	100% -5% P Test 5	33% +5% Q Test 31	66% +5% Q Test 21	100% +5% P Test 10
Trip time. Limit is 0.5 s <sup>8</sup>	0.288 s	0.295 s	0.269 s	0.231 s	0.341 s	0.297 s

**Protection – Frequency change, Vector Shift Stability test:** This test should be carried out in accordance with EREC G98 Annex A1 A.1.2.6 (Inverter connected) or Annex A2 A.2.2.6 (Synchronous). Confirmation is required that the Micro-generating Plant does not trip under positive / negative vector shift.

	Start Frequency	Change	Confirm no trip
Positive Vector Shift	49.0 Hz	+50 degrees	No trip
Negative Vector Shift	50.0 Hz	- 50 degrees	No trip

**Protection – Frequency change, RoCoF Stability test:** The requirement is specified in section 11.3, test procedure in Annex A.1.2.6 (Inverter connected) or Annex A2 A.2.2.6 (Synchronous). Confirmation is required that the Micro-generating Plant does not trip for the duration of the ramp up and ramp down test.

Ramp range	Test frequency ramp:	Test Duration	Confirm no trip
49.0 Hz to 51.0 Hz	+0.95 Hzs <sup>-1</sup>	2.1 s	No trip
51.0 Hz to 49.0 Hz	-0.95 Hzs <sup>-1</sup>	2.1 s	No trip

**Limited Frequency Sensitive Mode – Overfrequency test:** This test should be carried out in accordance with A.1.2.8. The test should be carried out using the specific threshold frequency of 50.4 Hz and Droop of 10%. The measurement tolerances are contained in A.1.2.8.

<sup>8</sup> If the device requires additional shut down time (beyond 0.5 s but less than 1 s) then this should be stated on this form.

Test sequence at <b>Registered Capacity &gt;80%</b>	Measured <b>Active Power</b> Output(W)	Frequency	Primary Power Source	<b>Active Power Gradient</b>
Step a) 50.00 Hz ±0.01 Hz	3271	50.00	DC SOURCE	NA
Step b) 50.45 Hz ±0.05 Hz	3241	50.45		10.90%
Step c) 50.70 Hz ±0.10 Hz	3083	50.70		10.44%
Step d) 51.15 Hz ±0.05 Hz	2790	51.15		10.20%
Step e) 50.70 Hz ±0.10 Hz	3083	50.70		10.44%
Step f) 50.45 Hz ±0.05 Hz	3239	50.45		10.22%
Step g) 50.00 Hz ±0.01 Hz	3268	50.00		NA
Test sequence at <b>Registered Capacity 40% - 60%</b>	Measured <b>Active Power</b> Output(W)	Frequency		Primary Power Source
Step a) 50.00 Hz ±0.01 Hz	1649.6	50.00	DC SOURCE	NA
Step b) 50.45 Hz ±0.05 Hz	1634.1	50.45		10.64%
Step c) 50.70 Hz ±0.10 Hz	1557.8	50.70		10.78%
Step d) 51.15 Hz ±0.05 Hz	1423.4	51.15		10.94%
Step e) 50.70 Hz ±0.10 Hz	1552.2	50.70		10.16%
Step f) 50.45 Hz ±0.05 Hz	1632.1	50.45		9.43%
Step g) 50.00 Hz ±0.01 Hz	1649.4	50.00		NA

<b>Power output with falling frequency test:</b> This test should be carried out in accordance with A.1.2.7.			
Test sequence	Measured <b>Active Power</b> Output	Frequency	Primary power source
Test a) 50 Hz ± 0.01 Hz	3266 W	50.00 Hz	3382 W
Test b) Point between 49.5 Hz and 49.6 Hz	3266 W	49.55 Hz	3382 W
Test c) Point between 47.5 Hz and 47.6 Hz	3268 W	47.55 Hz	3376 W
NOTE: The operating point in Test (b) and (c) shall be maintained for at least 5 minutes			

Re-connection timer.					
Test should prove that the reconnection sequence starts after a minimum delay of 20 s for restoration of voltage and frequency to within the stage 1 settings of Table 2. Both the time delay setting and the measured delay should be provided in this form; both should be greater than 20 s to pass. Confirmation should be provided that the <b>Micro-generating Plant</b> does not reconnect at the voltage and frequency settings below; a statement of “no reconnection” can be made.					
Time delay setting	Measured delay	Checks on no reconnection when voltage or frequency is brought to just outside stage 1 limits of table 2.			
60 s	82 s	At 266.2 V	At 180.0 V	At 47.4 Hz	At 52.1 Hz
Confirmation that the <b>Micro-generator</b> does not re-connect.		No reconnection	No reconnection	No reconnection	No reconnection

Fault level contribution: These tests shall be carried out in accordance with EREC G98 Annex A1 A.1.3.5 (Inverter connected) and Annex A2 A.2.3.4 (Synchronous). Please complete each entry, even if the fault contribution is zero.					
For machines with electro-magnetic output			For <b>Inverter</b> output		
Parameter	Symbol	Value	Time after fault	Volts	Amps
Peak Short Circuit current	$i_p$		20 ms	0V	0A
Initial Value of aperiodic current	$A$		100 ms	0V	14.18A
Initial symmetrical short-circuit current*	$I_k$		250 ms	0V	0A
Decaying (aperiodic) component of short circuit current*	$i_{DC}$		500 ms	0V	0A
Reactance/Resistance Ratio of source*	$X/R$		Time to trip	101ms	In seconds
For rotating machines and linear piston machines the test should produce a 0 s – 2 s plot of the short circuit current as seen at the <b>Micro-generator</b> terminals.					
* Values for these parameters should be provided where the short circuit duration is sufficiently long to enable interpolation of the plot					
Logic Interface (input port)					
Confirm that an input port is provided and can be used to reduce the <b>Active Power</b> output to zero					Yes
Provide high level description of logic interface, e.g. details in 9.4.3 such as AC or <b>DC</b> signal (the additional comments box below can be used)					Yes
High level description of logic interface: By default the logic interface will take the form of a simple binary output that can be operated by a simple switch or contactor. When the switch is open the Power Generating Module can operate normally. When the switch is closes the Power Generating Module will reduce its Active Power to zero within 1 s.					

<b>Self-Monitoring solid state switching:</b> No specified test requirements. Refer to EREC G98 Annex A1 A.1.3.6 ( <b>Inverter</b> connected).	NA
It has been verified that in the event of the solid state switching device failing to disconnect the <b>Micro-generator</b> , the voltage on the output side of the switching device is reduced to a value below 50 V within 0.5 s.	
<b>Cyber security</b>	
Confirm that the <b>Manufacturer</b> or <b>Installer</b> of the <b>Micro-generator</b> has provided a statement describing how the <b>Micro-generator</b> has been designed to comply with cyber security requirements, as detailed in 9.7.	Yes
<b>Additional comments</b>	